



Acoustical Surfaces, Inc.

SOUNDPROOFING, ACOUSTICS, NOISE & VIBRATION CONTROL SPECIALISTS

123 Columbia Court North • Suite 201 • Chaska, MN 55318

(952) 448-5300 • Fax (952) 448-2613 • (800) 448-0121

Email: sales@acousticalsurfaces.com

Visit our Website: www.acousticalsurfaces.com

We Identify and S.T.O.P. Your Noise Problem



SINCE 1896

REPORT

Intertek ETL SEMKO

3933 US ROUTE 11 CORTLAND, NEW YORK 13045



Accredited by the National Voluntary
Laboratory Accreditation Program for
the Specific Accreditation under Lab
Code 100402-0.

Order No. 3124189

Date: May 24, 2007

REPORT NO. 3124189CRT-002

**SOUND TRANSMISSION LOSS TEST
AND CLASSIFICATION OF A
ACOUSTI-BOARD Ultra™**

RENDERED BY MANUFACTURER AND RELEASED TO:

Acoustical Surfaces, Inc.
123 Columbia Court North
Chaska, MN 55318

INTRODUCTION

This report gives the results of a Sound Transmission Loss test and the determination of the Sound Transmission Class on a ACOUSTI-BOARD Ultra™. The panel was selected and supplied by the client and received at the laboratories on April 12, 2007. The sample appeared to be in a new, unused condition.

AUTHORIZATION

Signed Intertek Quotation No. 500033342.

TEST METHOD

The specimen was tested in accordance with The American Society for Testing and Materials designation ASTM E90-04, "Standard Test Method for Laboratory Measurement of Airborne Sound Transmission Loss of Building Partitions", and classified in accordance with the American Society for Testing and Materials designation ASTM E413-2004, "Classification for Rating Sound Insulation.

An independent organization testing for safety, performance, and certification.

This report is for the exclusive use of Intertek's Client and is provided pursuant to the agreement between Intertek and its Client. Intertek's responsibility and liability are limited to the terms and conditions of the agreement. Intertek assumes no liability to any party, other than to the Client in accordance with the agreement, for any loss, expense or damage occasioned by the use of this report. Only the Client is authorized to copy or distribute this report and then only in its entirety. Any use of the Intertek name or one of its marks for the sale or advertisement of the tested material, product or service must first be approved in writing by Intertek. The observations and test results in this report are relevant only to the sample tested. This report by itself does not imply that the material, product, or service is or has ever been under an Intertek certification program. Measurement uncertainty budgets have been determined for applicable test methods and are available upon request.

-
- Soundproofing Products • Sonex™ Ceiling & Wall Panels • Sound Control Curtains • Equipment Enclosures • Acoustical Baffles & Banners • Solid Wood & Veneer Acoustical Ceiling & Wall Systems
 - Professional Audio Acoustics • Vibration & Damping Control • Fire Retardant Acoustics • Hearing Protection • Moisture & Impact Resistant Products • Floor Impact Noise Reduction
 - Sound Absorbers • Noise Barriers • Fabric Wrapped Wall Panels • Acoustical Foam (Egg Crate) • Acoustical Sealants & Adhesives • Outdoor Noise Control • Assistive Listening Devices
 - OSHA, FDA, ADA Compliance • On-Site Acoustical Analysis • Acoustical Design & Consulting • Large Inventory • Fast Shipment • No Project too Large or Small • Major Credit Cards Accepted



Acoustical Surfaces, Inc.

SOUNDPROOFING, ACOUSTICS, NOISE & VIBRATION CONTROL SPECIALISTS

123 Columbia Court North • Suite 201 • Chaska, MN 55318
(952) 448-5300 • Fax (952) 448-2613 • (800) 448-0121
Email: sales@acousticalsurfaces.com
Visit our Website: www.acousticalsurfaces.com

We Identify and S.T.O.P. Your Noise Problem

Report No. 3124189CRT-002

Page 2 of 5

May 24, 2007

GENERAL

The sound-insulating property of a partition element is expressed in terms of the sound transmission loss. The procedure for determining this quantity is to mount (and perimeter seal) the test specimen as a partition between two reverberation rooms. Sound is introduced in one of the rooms (the source room) and measurements are made of the noise reduction between source room (10,000 cu. ft.) and receiving room (16,640 cu. ft.). The rooms are so arranged and constructed that the only significant sound transmission between them is through the test specimen.

The test opening is constructed such that it is approximately one inch larger in size than the test specimen. The specimen is placed in the test opening on a half-inch bead of "DUX-SEAL", a dense, non-hardening, clay-like material, to isolate it from the supporting base. The space between the test specimen and the wall opening is sealed on both sides employing the same sealing material.

The purpose of the Sound Transmission Class (STC) is to provide a single figure rating that can be used for comparing the sound-insulating properties of partition elements used for general building design purposes. The higher the rating (STC) the greater the sound insulating properties of the partition.

DESCRIPTION OF TEST SPECIMEN

The test specimen consisted of a 36 inch wide by 60 inch long by nominal ½ inch thick ACOUSTI-BOARD Ultra™. installed vertically between the reverberation rooms. It weighed 1.2 pounds per square foot.



Accredited by the National Voluntary
Laboratory Accreditation Program for
the Specific Accreditation under Lab
Code 100402-0.



Acoustical Surfaces, Inc.

SOUNDPROOFING, ACOUSTICS, NOISE & VIBRATION CONTROL SPECIALISTS

123 Columbia Court North • Suite 201 • Chaska, MN 55318

(952) 448-5300 • Fax (952) 448-2613 • (800) 448-0121

Email: sales@acousticalsurfaces.com

Visit our Website: www.acousticalsurfaces.com

We Identify and **S.T.O.P.** Your Noise Problem

Report No. 3124189CRT-002

Page 3 of 5

May 24, 2007

RESULTS OF TEST

<u>1/3 Octave Band Center Frequency Hz</u>	<u>Sound Transmission Loss in dB</u>
80	9
100	13
125	12
160	15
200	14
250	14
315	12
400	13
500	13
630	13
800	14
1000	14
1250	14
1600	15
2000	17
2500	18
3150	20
4000	21
5000	22
Sound Transmission Class	15

PRECISION

For any pair of rooms and microphone system, the 95% confidence interval ΔTL , for transmission loss must be less than the following.

<u>Range of One-Third Octave Bands</u>	<u>Transmission Loss Uncertainty, dB</u>	
	<u>Required</u>	<u>Actual</u>
125 and 160	3	<1.5
200 and 250	2	<1.5
315 - 4000	1	<1



ETL SEMKO



Accredited by the National Voluntary
Laboratory Accreditation Program for
the Specific Accreditation under Lab
Code 100402-0.

- Soundproofing Products • Sonex™ Ceiling & Wall Panels • Sound Control Curtains • Equipment Enclosures • Acoustical Baffles & Banners • Solid Wood & Veneer Acoustical Ceiling & Wall Systems
- Professional Audio Acoustics • Vibration & Damping Control • Fire Retardant Acoustics • Hearing Protection • Moisture & Impact Resistant Products • Floor Impact Noise Reduction
- Sound Absorbers • Noise Barriers • Fabric Wrapped Wall Panels • Acoustical Foam (Egg Crate) • Acoustical Sealants & Adhesives • Outdoor Noise Control • Assistive Listening Devices
- OSHA, FDA, ADA Compliance • On-Site Acoustical Analysis • Acoustical Design & Consulting • Large Inventory • Fast Shipment • No Project too Large or Small • Major Credit Cards Accepted



Acoustical Surfaces, Inc.

SOUNDPROOFING, ACOUSTICS, NOISE & VIBRATION CONTROL SPECIALISTS

123 Columbia Court North • Suite 201 • Chaska, MN 55318

(952) 448-5300 • Fax (952) 448-2613 • (800) 448-0121

Email: sales@acousticalsurfaces.com

Visit our Website: www.acousticalsurfaces.com


We Identify and S.T.O.P. Your Noise Problem

Report No. 3124189CRT-002

Page 4 of 5

May 24, 2007

Sound Transmission Loss

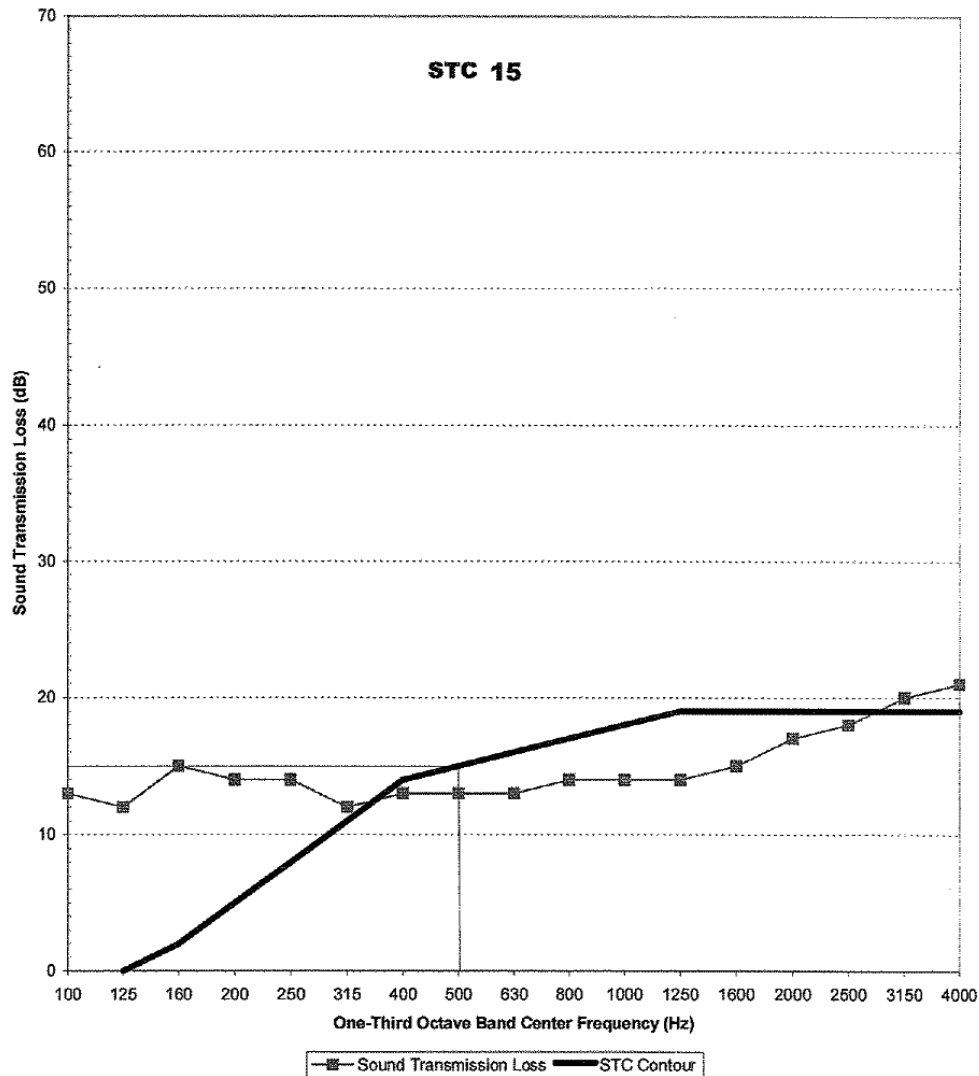



Acoustical Surfaces, Inc.

SOUNDPROOFING, ACOUSTICS, NOISE & VIBRATION CONTROL SPECIALISTS

123 Columbia Court North • Suite 201 • Chaska, MN 55318

(952) 448-5300 • Fax (952) 448-2613 • (800) 448-0121

Email: sales@acousticalsurfaces.com

Visit our Website: www.acousticalsurfaces.com

We Identify and S.T.O.P. Your Noise Problem

Report No. 3124189CRT-002

Page 5 of 5

May 24, 2007

REMARKS

1. Curing Period - None
2. Ambient Temperature: 70°F
3. Relative Humidity: 36%

CONCLUSION

The test method employed for this test has no pass-fail criteria, therefore, the evaluation of the test results is left to the discretion of the client.

This report must not be used by the client to claim product certification, approval, or endorsement by NVLAP, NIST, or any agency of the federal government.

Date of Test: May 17, 2007

Report Approved by:

Patrick J. Schoof
Engineering Team Leader
Acoustical Testing

Report Reviewed By:

James R. Kline
Engineer/Quality Supervisor
Acoustical Testing

Attachments: None